


NORDYNE

February 28, 2003

To Whom It May Concern:

The attached drawing shows an approved alternate method of venting an M3 series furnace. As noted, the maximum vertical rise shall be no more than 10 feet. The termination at the soffit may be two pipe, separated by no less than eight inches and no more than 36 inches, or Nordyne Concentric Vent Termination Kit 903578.


Sincerely,

A handwritten signature in black ink, appearing to read 'Jim Crofoot', with a long horizontal line extending to the right.

Jim Crofoot
Engineering Director

8000 Phoenix Pkwy
P.O. Box 8809
O'Fallon, MO 63366
636/561-7300

ALTERNATE M3 SERIES FURNACE VENT PIPING METHOD

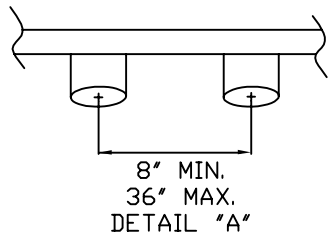

3" PVC, CPVC, OR ABS
VENT PIPE

10 FEET MAXIMUM RISE.
MAXIMUM TOTAL EQUIVALENT LENGTH
AS DETAILED IN INSTALLATION INSTRUCTIONS.

TERMINATION MAY BE
TWO PIPE (SEE DETAIL "A")
OR CONCENTRIC VENT TERMINATION
903578.

NOTE:
THIS METHOD APPLIES TO
BOTH INTAKE AND EXHAUST.
DOWNWARD PITCH MUST BE
MAINTAINED TO SOFFIT
OUTLET. SMALL ICICLES MAY
FORM AT THE EXHAUST AFTER
A HEATING CYCLE BUT WILL
MELT DURING THE NEXT
HEATING CYCLE. ALL OTHER
CONSTRAINTS OUTLINED IN
THE INSTALLATION
INSTRUCTIONS APPLY.

M3 SERIES FURNACE

M3 COIL BOX

